


## Safety switch Series SKT

Description **SKT-U1Z**

Article number **6016419176**

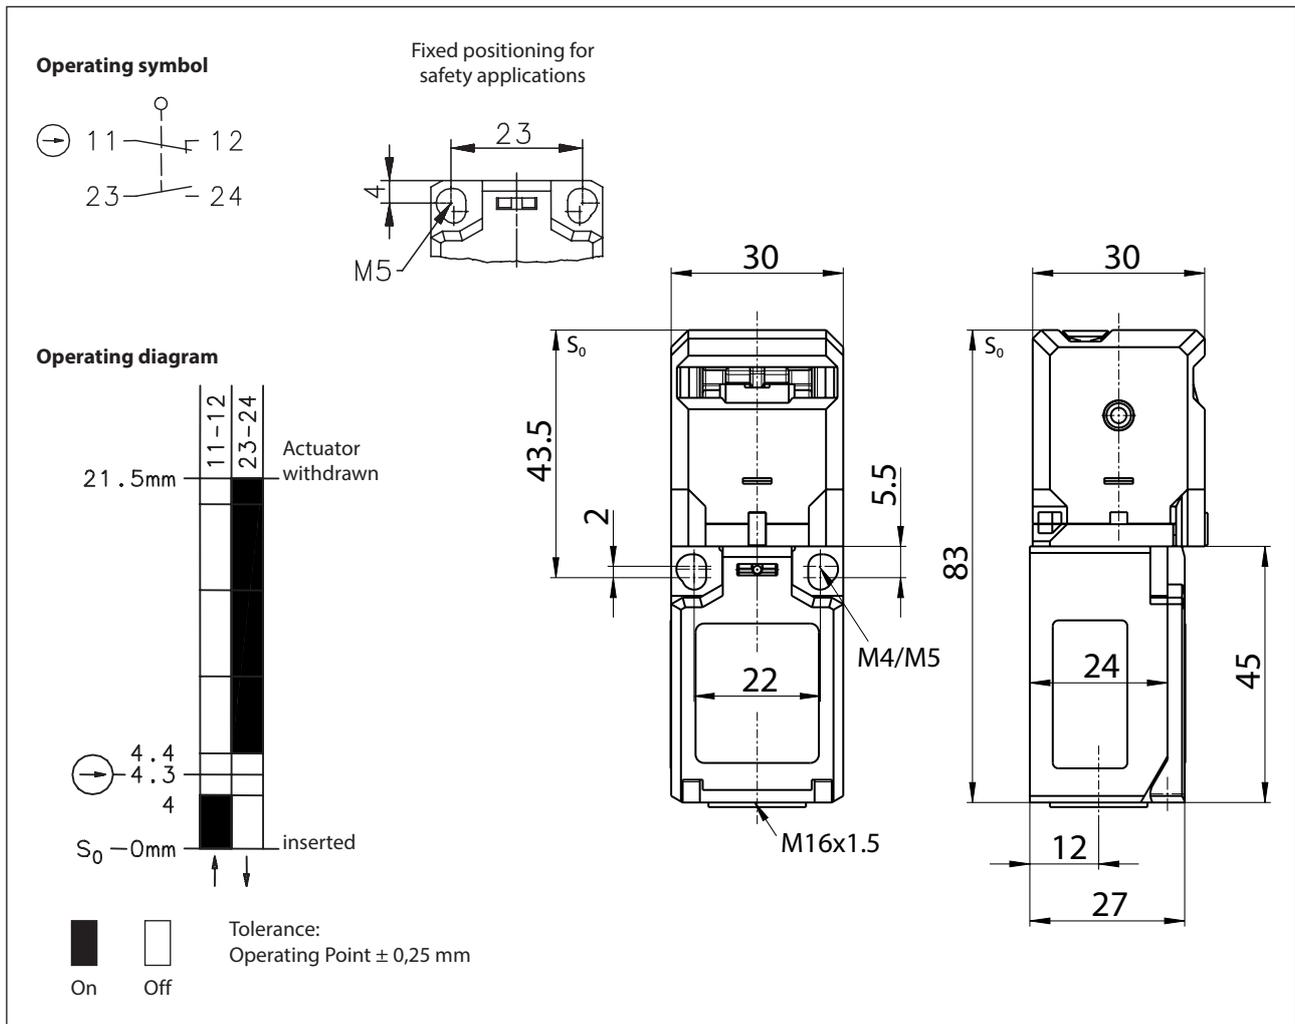


### Electrical Data

Rated insulation voltage	$U_i$	250 V AC
Conv. thermal current	$I_{the}$	10 A
Utilization category		AC-15, $U_e / I_e$ 240 V / 3 A; DC-13, $U_e / I_e$ 250 V / 0,27 A
Direct opening action	$\ominus$	according to IEC/EN 60947-5-1, Annex K
Short-circuit protective device		Fuse 6 A gG
Protection class	$\square$	II

Mechanical data	
Enclosure	PBT
Cover	PA 6.6
Extraction force	10 N
Ambient air temperature	-30 °C ... +80 °C
Contact type	1 NC, 1 NO (Zb)
Mechanical life	1 x 10 <sup>6</sup> switch operations
Switching frequency	≤ 30 / min.
Assembly	2 x M4 / 2 x M5 for safety applications
Connection	4 screw connections (M3,5)
Conductor cross-sections	0,5 ... 1,5 mm <sup>2</sup> (solid or stranded wire with ferrules)
Cable entrance	1 x M16 x 1,5
Weight	≈ 0,07 kg
Protection type	IP65 acc. to IEC/EN 60529

ID for safety engineering	
B10d	2 x 10 <sup>6</sup> cycles (@ DC-13; 24 V; Ie2 = 0,1 A)

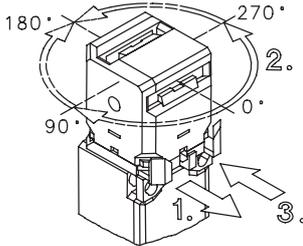Actuation	
<ol style="list-style-type: none"> <li>1. draw clasp out</li> <li>2. turn actuator head (4 x 90° rotation)</li> <li>3. press-on clasp</li> </ol>	

Standards	
	DIN EN 60947-5-1
	DIN EN ISO 13849-1
	DIN EN ISO 14119

EU Conformity	
	acc. to directive 2006/42/EC (Machinery Directive)

UK Conformity	
	Supply of Machinery (Safety) Regulations 2008, 2008 No. 1597

Approvals	
	TÜV Rheinland, Product Safety
	CCC
	cUL <sub>US</sub> A300, Q300 (same polarity)
	cCSA <sub>US</sub> A300, Q300 (same polarity)

**Notes**


The specified degree of protection (IP code) of the safety switch only applies when the cover is closed and an at least equivalent cable gland with corresponding cable or corresponding cable coupling is used.

The arrangement and fastening of the safety switch and actuator must be carried out in accordance with DIN EN ISO 14119.

With radius actuation, the mechanical service life may be reduced.

The minimum radii can be found in the data sheet of the respective actuator or in the operating and mounting instructions of the switchgear and apply to a pivot point on the level of the upper edge of the enclosure  $S_0$ .

The actuator slot that is not used must be closed by the cover.

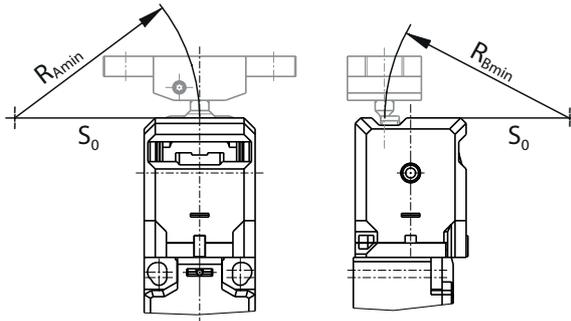

$R_{Amin}$  and  $R_{Bmin}$  depend on the actuator.

Applies accordingly also to lateral retraction directions.